


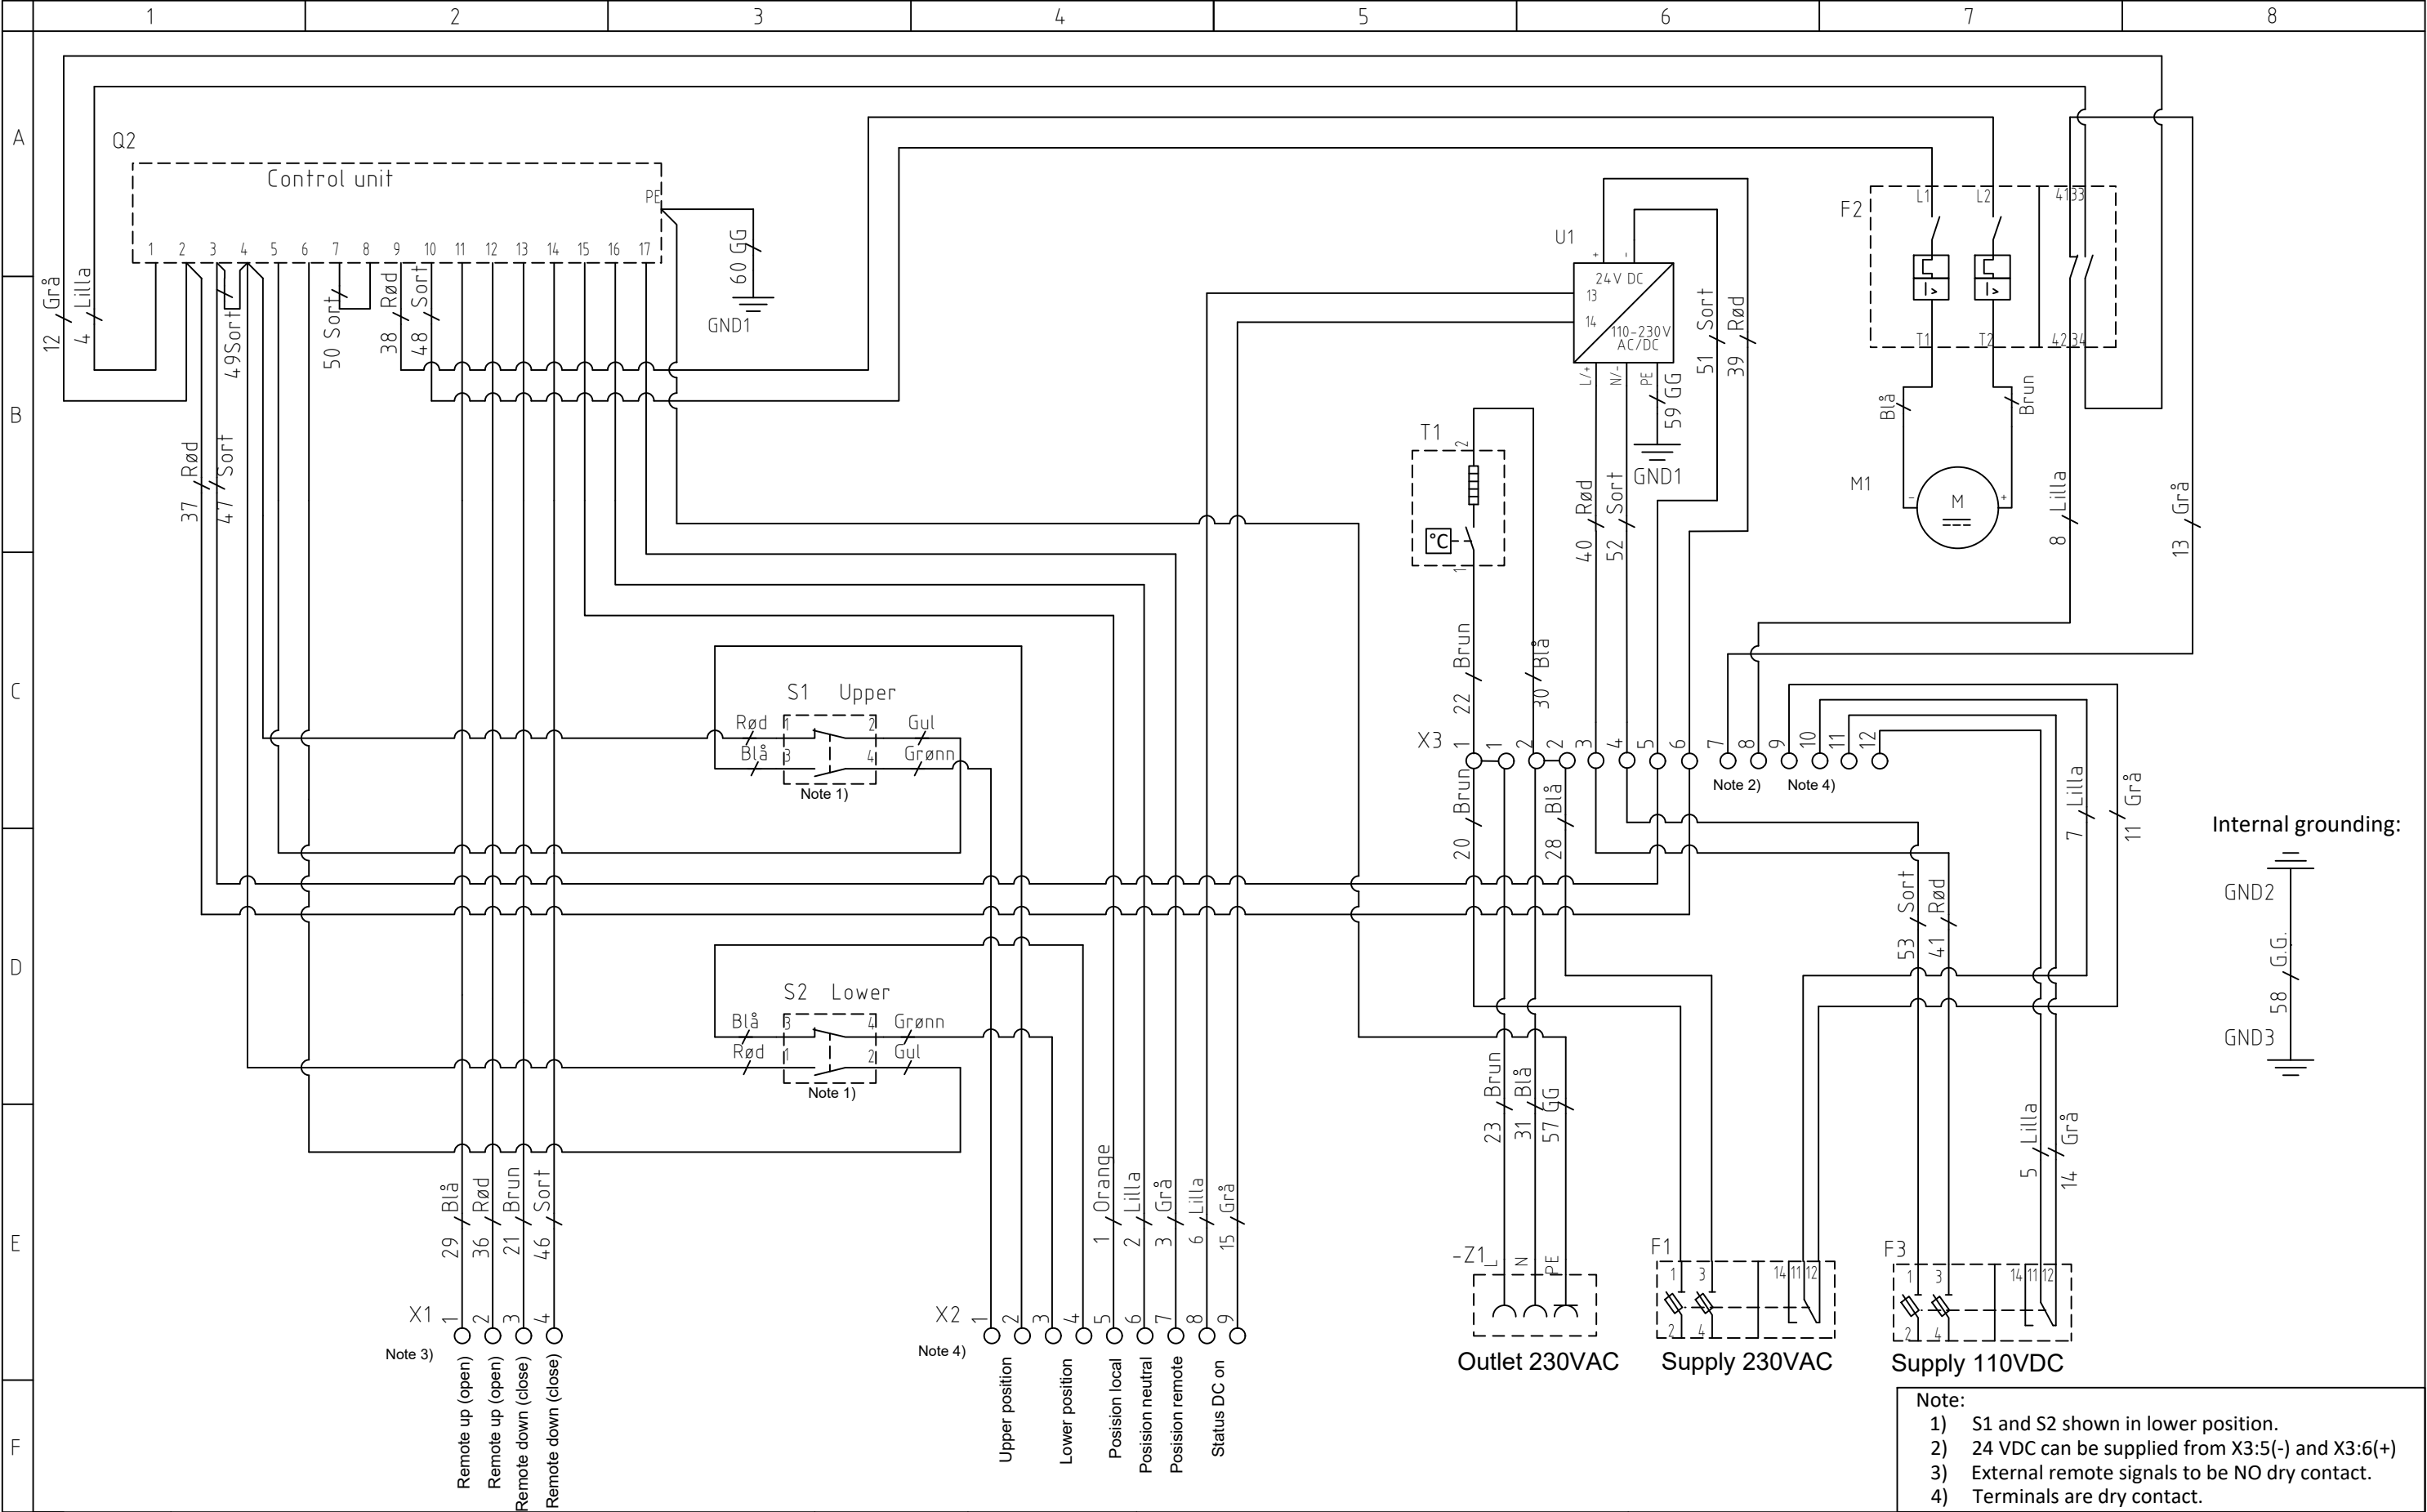

Note:
1) S1 and S2 shown in lower position.
2) 24 VDC can be supplied from X3:5(-) and X3:6(+)
3) External remote signals to be NO dry contact.
4) Terminals are dry contact.

Rev. J	Description Byttet om på ledninger fra aktuator			Rev. sign SAa	Rev. date 13.03.2024	Ownership and copyright: 	Bryterstyring Koblingsskjema BL24-110-230-S-IO-AL393		
Created by Steinar	Creation date 28.02.2020	Approved by Andreas	Approved date 13.03.2024				07-A1351	Rev. J	Page 1/1